



**Associated Electric Cooperative Inc.**

A Touchstone Energy® Cooperative 

## **New Madrid CCR Surface Impoundment**

# **Pond 003**

Disposal of Coal Combustion Residuals (CCR) from  
Electric Utilities Final Rule Structural Integrity Criteria for  
Existing CCR Surface Impoundments

# **Emergency Action Plan**

*This Emergency Action Plan is written in accordance with  
40 CFR §257.73(a)(3)(i)(A) through (E) and (a)(3)(iv)*

**18 April 2022**

**Prepared By:**

**HALEY  
ALDRICH**

**Project ID: 129342-046**

---

# New Madrid CCR Surface Impoundment Pond 003 Emergency Action Plan

## Table of Contents

<b>1.0</b>	<b>CCR Surface Impoundment Emergency Action Plan Introduction .....</b>	<b>1</b>
<b>1.1</b>	<b>Notification Procedure.....</b>	<b>1</b>
<b>1.2</b>	<b>Potential Impacted Area .....</b>	<b>1</b>
<b>1.3</b>	<b>Directions to Impoundment.....</b>	<b>1</b>
<b>2.0</b>	<b>Pond 003 Physical Description and Structural Integrity Hazard Potential Classification.....</b>	<b>2</b>
<b>2.1</b>	<b>Physical Description.....</b>	<b>2</b>
<b>2.2</b>	<b>Hazard Potential Classification .....</b>	<b>3</b>
<b>3.0</b>	<b>Safety Emergency Recognition and Prevention.....</b>	<b>3</b>
<b>3.1</b>	<b>Emergency Definitions and CCR Surface Impoundment Potential Risk .....</b>	<b>3</b>
<b>3.2</b>	<b>Site and Impoundment Condition Surveillance.....</b>	<b>3</b>
<b>3.3</b>	<b>Detection and Monitoring Devices.....</b>	<b>3</b>
<b>4.0</b>	<b>Notification Procedures .....</b>	<b>4</b>
<b>4.1</b>	<b>Notification Sequence.....</b>	<b>4</b>
<b>4.2</b>	<b>Modes of Communication with Responsible Persons .....</b>	<b>5</b>
<b>4.3</b>	<b>Notification of Potentially Affected Residents and Businesses .....</b>	<b>5</b>
<b>4.4</b>	<b>Notification Responsibilities .....</b>	<b>6</b>
<b>5.0</b>	<b>Emergency Operations and Repair .....</b>	<b>6</b>
<b>5.1</b>	<b>Response During Adverse Conditions .....</b>	<b>6</b>
<b>6.0</b>	<b>Annual Face to Face Meeting with Local Emergency Responders .....</b>	<b>6</b>
<b>7.0</b>	<b>Professional Engineer Certification .....</b>	<b>8</b>

Figure 1 Aerial Photo Map of the AECI New Madrid Power Plant and CCR Surface Impoundments

Figure 2 Aerial Photo Map of Pond 003

Figure 3 Pond 003 Flood Inundation Map

Figure 4 Map and Directions from New Madrid, Missouri to Pond 003

Professional Engineer Certification

## **1.0 CCR Surface Impoundment Emergency Action Plan Introduction**

This Emergency Action Plan (EAP, Plan) is prepared in accordance with the United States Environmental Protection Agency's CCR Rule effective 19 October 2015 including subsequent revisions, specifically Code of Federal Regulations Title 40 (40 CFR) §257.73(a)(3)(i). Haley & Aldrich, Inc. (Haley & Aldrich) has completed this Plan on behalf of Associated Electric Cooperative, Inc. (AECI). The Initial Emergency Action Plan for Pond 003 was completed on 17 April 2017.

Per 40 CFR §257.73(a)(3)(i), any surface impoundment that has been listed as having a significant hazard potential must have an EAP. The purpose of this EAP is to reduce the risk to human life and minimize property damage during an unusual or emergency event at the New Madrid Power Plant (NMPP) CCR surface impoundments. This EAP will prepare the facility personnel for a surface impoundment failure event.

AECI has developed and will implement this EAP in the event an impoundment failure occurs at their NMPP CCR Surface Impoundment – Pond 003 (Pond 003) (see Figures 1 and 2). In addition, this Plan is written in accordance, and to comply, with 40 CFR §257.73(a)(3)(i). This EAP provides step-by-step instructions to those individuals at the NMPP level on how to respond to an emergency situation. The Plan includes notification lists, maps of the CCR surface impoundment, and emergency response procedures. The main goal of this EAP is to offer a quick and effective reference for personnel at the facility in case such an emergency should occur.

### **1.1 Notification Procedure**

This EAP provides general guidance for recognizing and characterizing an emergency situation occurring at the impoundment. The impoundment owner/plant manager should act quickly to evaluate the situation and then follow the notification procedures according to the corresponding level of emergency.

### **1.2 Potential Impacted Area**

The Flood Inundation Map for Pond 003 (Figure 3) indicates the potential areas that may be affected if the impoundment should fail. Based on the flood inundation mapping, the potentially affected areas include uninhabited farmland to the south and southwest, the AECI NMPP property to the northwest, and other industrial facilities to the west. No other structures or buildings have been identified in this inundation area.

### **1.3 Directions to Impoundment**

A map with directions to the site for emergency personnel is shown on Figure 4 - Map and Directions from New Madrid, Missouri to Pond 003.

Pond 003 is located north of County Road 408 (latitude/longitude: 36°30'28"/89°33'27") and can be accessed via Levee Road. A gravel access road is present on the southern embankment crest and an asphalt access road is present on the western embankment crest (see Figure 4).

Directions from New Madrid:

Head southwest on US HWY 61 towards Interstate 55 (I-55)  
Merge onto I-55 South toward Portageville  
Take exit 40 for State Hwy EE toward Marston/St. Jude Road  
Continue on State Hwy EE. Turn left at the railroad tracks  
Follow the road to the east to Levee Road  
Take Levee Road south to Pond 003

## **2.0 Pond 003 Physical Description and Structural Integrity Hazard Potential Classification**

### **2.1 Physical Description**

Pond 003 is a ring dike comprised of Ash Pond 1, Slag Pond 1, and the Unlined Ash Pond, which were constructed in or around 1972. Ash Pond 1, Slag Pond 1, and the Unlined Ash Pond were originally built to serve as sedimentation and storage basins for fly ash and boiler slag generated from the NMPP unit that was constructed at the same time. The Pond 003 operator has general maintenance and repair procedures in place, and there are no known occurrences of structural instability of Pond 003.

The watershed in which Pond 003 is located is the Little River Ditches Watershed (USGS No. 08020204) that is approximately 2,608 square miles in size. Pond 003 is an above-grade ring dike and does not receive any overland flow from the surrounding areas. Discharges from the impoundment flow to a concrete drip inlet structure with concrete stoplogs located in the southeast corner of Pond 003. A discharge pipe directs water through the dike and into a discharge channel that flows to the Mississippi River as shown on Figure 2.

Pond 003 is located approximately 400 feet west of the Mississippi River, on the east side of the Mississippi River levee system, with the west embankment comprised of the levee. Pond 003 embankments were constructed from native silty clay with 3H:1V (horizontal: vertical) upstream and downstream slopes and a crest height ranging from approximately 12 to 20 feet. The top of the embankments generally match the elevation of the Mississippi River levees.

Maximum depths of impounded water and CCR are approximately 5 to 10 feet and approximately 30 feet, respectively, with a corresponding water elevation of 298.6 feet NAVD88.

The storage capacity of Pond 003 (per the original surface impoundment design with a 110-acre footprint) is approximately 1,700 acre-ft. The volume of CCR material currently stored is approximately 2.9 million cubic yards.

The above depths, elevations, storage capacity and impounded volumes are based on: 1) available measured water surface elevations; 2) survey conducted 4-8 October 2014 by Pictometry International Corporation; 3) topography provided by USGS 1971; and 4) *Periodic Structural Stability Assessment of Pond 003* dated 15 October 2021 by Haley & Aldrich.

CCR, coal pile runoff and plant process water are discharged into Pond 003 via three pipes located at the northern end of the impoundment. The discharged process water and CCR flow through a channel in the stockpiled/settled ash. Discharges from the impoundment flow to a concrete decant structure with concrete stoplogs. A discharge pipe directs water through the dike and into a discharge channel which flows to the Mississippi River.

## **2.2 Hazard Potential Classification**

Based on the criteria of 40 CFR §257.73 *Structural integrity criteria for existing CCR surface impoundments*, the determination has been made that Pond 003 meets the classification of a significant hazard potential CCR surface impoundment (defined as a diked surface impoundment where failure or mis-operation results in no probable loss of human life, but can cause economic loss, environmental damage, disruption of lifeline facilities, or impact other concerns). This classification is based on the high probability that failure of the embankment could result in environmental damage extending beyond the boundaries of the New Madrid Power Plant and the possibility of power generation interruption. Additional information regarding the classification of Pond 002 can be found in the *Periodic Hazard Potential Classification Assessment of Pond 003* dated 15 October 2021 by Haley & Aldrich.

## **3.0 Safety Emergency Recognition and Prevention**

### **3.1 Emergency Definitions and CCR Surface Impoundment Potential Risk**

Imminent/Actual Failure - Description: Impending or actual sudden release of water and/or boiler slag and fly ash caused by an accident to, or failure of, CCR surface impoundment structures.

Example: Failure of a segment of the perimeter dike by seepage and/or slope instability.

Potential Hazard - Description: Potential for sudden release of water and/or boiler slag and fly ash caused by an accident to, or failure of, CCR surface impoundment structures. Actions taken during such potentially hazardous events may prevent or mitigate failure. Even if failure is inevitable, in potential hazard situations, more time is generally available in potential hazard situations than in the imminent/actual failure situation to issue warnings and/or take mitigative actions.

Pond 003 contains approximately 1,750 acre-ft. of water and CCR material (1,732 acre-ft. of CCR and 18 acre-ft. of water) based on data from the *Periodic Structural Stability Assessment of Pond 003* dated 15 October 2021 by Haley & Aldrich. If the impoundment were to break on the east side, the material in the impoundment would flow into the Mississippi River. If the impoundment were to break on any of the remaining sides of the Pond 003 impoundment, the majority of the material would inundate approximately 1,000 feet around the Pond 003 perimeter. This includes area between Pond 003 and the closed Pond 004, sections of the NMPP and industrial complex to the west, uninhabited farmland to the southwest. Preventative measures to avoid an impoundment failure include visual inspections as detailed below.

### **3.2 Site and Impoundment Condition Surveillance**

Pond 003 has oversight by facility personnel and/or their designees to check Pond 003 at a maximum interval of seven days per 40 CFR §257.83(a)(i). The impoundment is inspected for erosion, wash outs, the presence of water near the impoundment toe, and other indicators of potential impoundment failure. Repairs are made as animal burrows are noted.

### **3.3 Detection and Monitoring Devices**

There are no piezometers installed in Pond 003 for stability monitoring.

## **4.0 Notification Procedures**

### **4.1 Notification Sequence**

In the event of a failure at Pond 003, general guidance for determining the emergency level is provided below, as well as the appropriate contacts for each level. This information should be used as a general guide for recognizing and characterizing the type of emergency situation occurring at the impoundment. Per the instructions of local emergency services personnel, 911 should be contacted<sup>1</sup> during emergency situations; all pertinent emergency services will be contacted by 911 personnel. Appropriate parties will be notified based on the nature and severity of the incident as determined by the incident commander/designee assigned by AECI. This applies to both emergency conditions, “Imminent Failure” and “Potential Hazard” as previously defined.

If failure is imminent or has occurred, notification and mitigation procedures are a top priority. The incident commander/designee, in conjunction with the Control Room Operator, is responsible for this determination. If the chain of notification is altered/broken, order needs to be reestablished immediately to ensure that every party is notified as required.

#### **Guidance for Determining the Emergency Level**

##### **Level 1 Emergency - Nonemergency, unusual event, slow to develop**

- **Contact:** Control Room Operator / Incident Commander
- Reservoir elevation at emergency spillway crest or spillway is flowing with no active erosion.
- New seepage areas with clear discharge in or near the impoundment.
- New cracks in the embankment less than ¼-inch wide without seepage.
- Visual movement/slippage of the embankment slope.
- Measurable earthquake felt or reported on or within 50 miles of the impoundment.
- Damage (vandalism/sabotage) to impoundment or appurtenances with no impacts to the functioning of the impoundment.
- Modification (vandalism/sabotage) to the impoundment or appurtenances that could adversely impact the functioning of the impoundment.

##### **Level 2 Emergency - Potential impoundment failure situation, rapidly developing**

- **Contact:** Control Room Operator / Incident Commander
- Spillway flowing with active gully erosion.
- New seepage areas with cloudy discharge or increasing flow rate.
- New cracks in the embankment greater than ¼-inch wide with seepage.
- New cracks in the embankment greater than ¼-inch but less than 6-inches without seepage.

---

<sup>1</sup> This procedure should be re-evaluated at each annual face-to-face meeting described in Section 6.

- Observation of new sinkhole in impoundment area, on embankment, or downstream of impoundment.
- Cracks in the embankment with seepage.
- Earthquake resulting in visible damage to the impoundment or appurtenances.
- Verified bomb threat that, if carried out, could result in damage to the impoundment.
- Damage to impoundment (vandalism/sabotage) or appurtenances that has resulted in seepage flow.

### **Level 3 Emergency - Urgent; impoundment failure imminent or is in progress**

- **Contact:** Control Room Operator / Incident Commander; 911
- Spillway flowing with an advancing headcut that is threatening the control section.
- Water from the reservoir is flowing over the top of the impoundment (not just auxiliary/emergency spillway).
- A whirlpool is observed in the reservoir.
- Seepage that is obviously eroding soil from within the embankment or rapidly increasing in flow rate.
- Rapidly enlarging sinkhole.
- Sudden or rapidly progressing slides of the embankment slopes.
- Earthquake resulting in uncontrolled release of water from the impoundment.
- Detonated bomb that has resulted in damage to the impoundment or appurtenances.
- Damage to impoundment (vandalism/sabotage) or appurtenances that has resulted in uncontrolled water release.

## **4.2 Modes of Communication with Responsible Persons**

The primary modes of communication with responsible persons are land-line telephones and cell phones. If someone cannot be contacted for any reason, then an alternate person performing the position will be contacted. If land-line telephones or cell phones are out of order, an alternate mode of communication listed below will be used:

- Two-way radios
- Gaitronics System
- Paging System
- Deliver in person
- Satellite Radiotelephone

AECI uses landlines and cell phones for routine communication purposes. If needed, other parties have equipment and personnel available to aid with communication with the local police/sheriff and county emergency management personnel.

## **4.3 Notification of Potentially Affected Residents and Businesses**

The incident commander/designee at the New Madrid Station will determine who to notify in the case of an imminent or actual Pond 003 failure.

Note inundation mapping indicates neither loss of human life nor buildings/structures is anticipated in the event of an actual failure (Level 3 Emergency).

#### **4.4 Notification Responsibilities**

The incident commander/designee will ensure proper notifications are made. Calling 911 will allow the dispatcher to send out all appropriate emergency response personnel as requested and/or needed for the particular incident. The New Madrid County Emergency Management Service has a code red phone calling system, which can be activated to assist with any necessary notifications and appropriate responses.

### **5.0 Emergency Operations and Repair**

The objective of the emergency operations and repair is to prevent or reduce the impact of an impending sudden release of water and/or boiler slag and fly ash. It should be anticipated that this work may need to be performed during adverse conditions and will require various supplies and resources. The primary methods of mitigating potential impact are: regulating the flow, minimizing flooding potential, and coordinating emergency repairs. Ensure that all personnel undertaking emergency repair and mitigation activities are using proper safety precautions. Any of these activities that may cause bodily harm/loss of life to these personnel should not be attempted.

#### **5.1 Response During Adverse Conditions**

Appropriate contractors will be utilized to assist the incident commander/designee with any mitigative actions being taken. The objectives of the mitigative actions are to minimize the impact of any event that has occurred. AECI maintains contractors for assistance with emergency events for the NMPP.

Requests for assistance can be made to the County and State emergency offices and/or AECI's preferred environmental response contractors/consultants to assist with the incident and make recommendations to AECI concerning the equipment and materials needed to mitigate the incident.

### **6.0 Annual Face to Face Meeting with Local Emergency Responders**

An annual face to face meeting will be held with local emergency responders per 40 CFR §257.73 (a)(3)(E). The meeting will be held whether or not an incident occurred during the previous year. If an incident did occur, the annual meeting date may be moved to discuss the incident soon after it occurs. If no incidents have occurred, an annual meeting will be held to inform the local emergency responders about the CCR surface impoundment EAP and the role they would play in assisting the facility. In addition, the meeting will cover general information about the CCR surface impoundment. The potential risks the CCR surface impoundment may pose will be explained, as well as the preventative measures the NMPP is taking to avoid these potential issues. Documentation of the annual face-to-face meeting will be recorded and placed in the operating record for Pond 003. Table 1 provides contact information for the internal




emergency coordinators and external emergency response agencies that should be included in these meetings.

**Table 1 - New Madrid CCR Surface Impoundment EAP Notification List**

Agency / Organization	Principal Contact	Address	Primary Phone Number	Alternate Phone Number
<b>Internal Emergency Coordinators</b>				
Control Room Operator / Incident Commander			(573)643-2211	(573) 643-6239 (security desk)
<b>Emergency Response Agencies</b>				
New Madrid County Emergency Management System	Jim Harris	560 Mott St. P.O. Box 602 New Madrid, MO 63869	911	(573)748-2866 (office)
New Madrid County Sheriff's Department	Main Line	#2 Courthouse Square New Madrid, MO 63869	(573)748-2516	
Ambulance County Emergency Medical Service	Dispatch	340 US HWY 61 New Madrid, MO 63869	911	
Missouri Delta Medical Center	Main Line	1008 N. Main St. Sikeston, MO 63801	(573)471-1600	
Pemiscot Memorial Hospital	Main Line	946 East Reed St. Hayti, MO 63869	(573)359-1372	
New Madrid Fire Department	Jim Harris (Chief)	560 Mott St. P.O. Box 96 New Madrid, MO 63869	911	(573)748-2866
New Madrid Police Department	Joey Higginson (Chief) Brandon Hanner (Assistant Chief)	342 U.S. Highway 61 New Madrid, MO 63869	911	(573)748-2167
National Response Center (NRC)	Main Line	1200 Pennsylvania Ave, NW Washington DC 20460	1-800-424-8802	
Missouri Emergency Response Commission (MERC)	Main Line	2302 Militia Drive PO Box 116 Jefferson City, MO 65102	(573)526-9249	(573)634-2436
Missouri Department of Natural Resources, Environmental Emergency Response	Main Line	Environmental Services Program PO Box 176 Jefferson City, MO 65102	(573)634-2436	(573)526-3348
U.S. Coast Guard – 8 <sup>th</sup> District; St. Louis, MO	Main Line	1222 Spruce St. Suite 7.103 St. Louis, MO 63103	(314)269-2500	
U.S. Army Corps of Engineers – Memphis District	Main Line	167 N. Main St. Room B-202 Memphis, TN 38103	(901)544-3360	

## 7.0 Professional Engineer Certification

I hereby certify that this Emergency Action Plan for AECl's Pond 003 at the New Madrid Power Plant was prepared in accordance with the requirements of §257.73 of the USEPA's CCR Rule.

Signed:   
Certifying Engineer

Print Name: Steven F. Putrich  
Missouri License No.: 2014035813  
Title: Project Principal  
Company: Haley & Aldrich, Inc.

Professional Engineer's Seal:



## **FIGURES**

GIS FILE PATH: \\haleyaldrich.com\share\oak\_common\40616\_New\_Madrid\_Power\_Plant\GIS\Maps\2022\_03129342\_004\_0001\_AERIAL\_PHOTO\_MAP\_OF\_AECI\_NM.mxd — USER: hwachholz — LAST SAVED: 3/9/2022 1:42:29 PM



**NEW MADRID  
POWER PLANT**

*MISSISSIPPI RIVER*

**POND 003**

**LEGEND**

 CCR SURFACE IMPOUNDMENT



0 500 1,000  
SCALE IN FEET

AERIAL IMAGERY SOURCE: ESRI

**HALEY  
ALDRICH**

NEW MADRID CCR SURFACE IMPOUNDMENT  
POND 003 EMERGENCY ACTION PLAN  
AECI NEW MADRID POWER PLANT  
NEW MADRID, MISSOURI

**AERIAL PHOTO MAP OF THE AECI  
NEW MADRID POWER PLANT AND  
POND 003**

MARCH 2022

**FIGURE 1**



GIS FILE PATH: \\haleyaldrich.com\share\oak\_common\40616\_New\_Madrid\_Power\_Plant\GIS\Maps\2022\_031129342\_004\_0002\_AERIAL\_PHOTO\_MAP\_OF\_POND\_003.mxd — USER: hwachholz — LAST SAVED: 3/9/2022 1:03:34 PM



**LEGEND**

 CCR SURFACE IMPOUNDMENT



0 400 800  
SCALE IN FEET

AERIAL IMAGERY SOURCE: ESRI



NEW MADRID CCR SURFACE IMPOUNDMENT  
POND 003 EMERGENCY ACTION PLAN  
AECI NEW MADRID POWER PLANT  
NEW MADRID, MISSOURI

**AERIAL PHOTO MAP OF POND 003**

MARCH 2022

**FIGURE 2**






GIS FILE PATH: \\haleyaldrich.com\share\oak\_common\40616\_New\_Madrid\_Power\_Plant\GIS\Maps\2022\_031129342\_004\_0003\_FLOOD\_INUNDATION\_MAP\_FOR\_POND\_003.mxd — USER: hwachholz — LAST SAVED: 3/9/2022 1:00:20 PM



The limits of the inundation shown are approximate and should be used only as a guideline for establishing evacuation zones. Areas inundated will depend on actual failure conditions and may differ from the areas shown on this map.

**LEGEND**

-  ESTIMATED LIMITS OF INUNDATION
-  CCR SURFACE IMPOUNDMENT



AERIAL IMAGERY SOURCE: ESRI




NEW MADRID CCR SURFACE IMPOUNDMENT  
POND 004 EMERGENCY ACTION PLAN  
AECI NEW MADRID POWER PLANT  
NEW MADRID, MISSOURI

**POND 003 FLOOD INUNDATION MAP**

MARCH 2022

**FIGURE 3**

**Figure 4 – Map and Directions from New Madrid, Missouri to Pond 003**

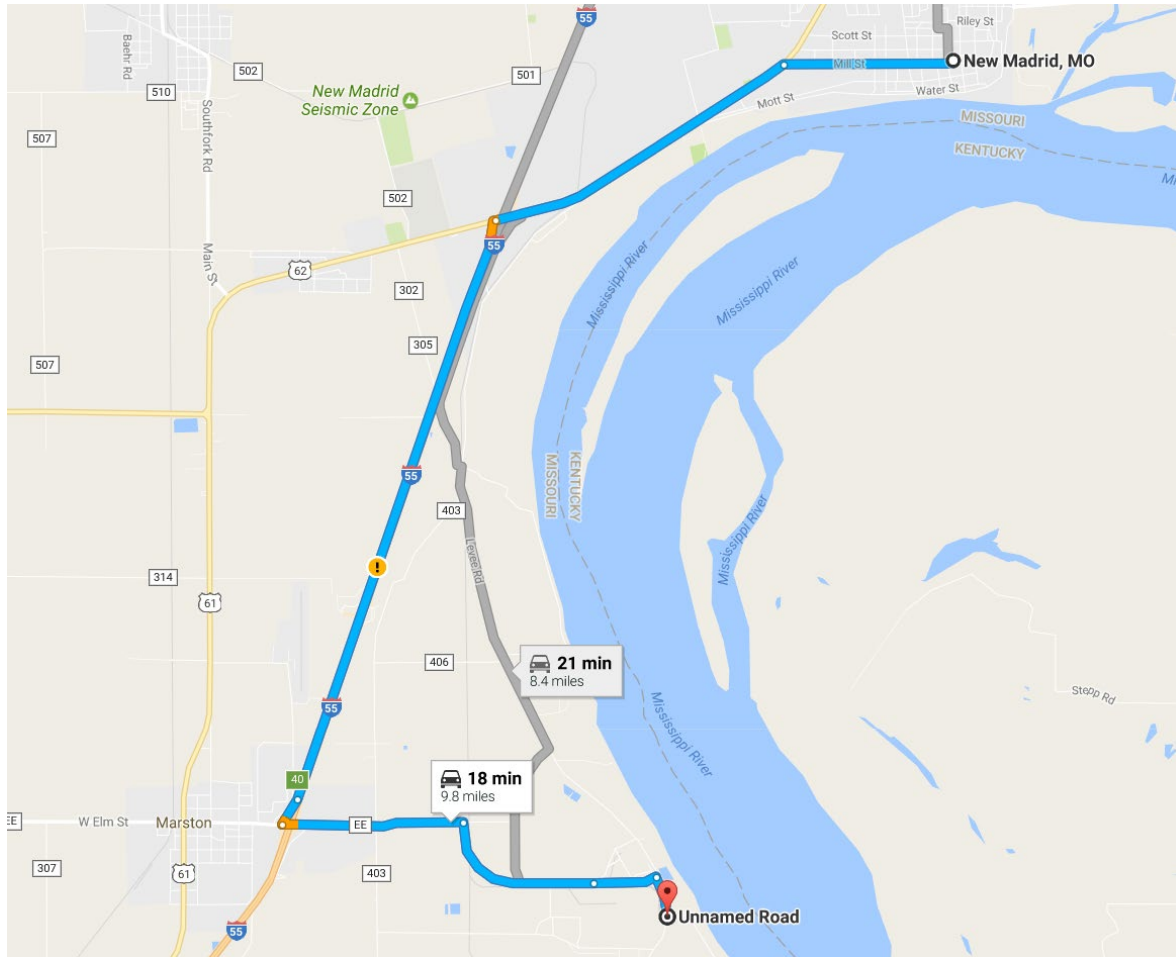

**Directions from New Madrid:**

- Head southwest on US HWY 61 towards Interstate 55
- Merge onto I-55 S toward Portageville
- Take exit 40 for State Hwy EE toward Marston/St. Jude Road
- Continue on State Hwy EE. Turn left at the railroad tracks.
- Follow the road to the east to Levee Road.
- Take Levee Road south to Pond 003.